# DOSITEC

# ÍNDICE

---

⚠ **SAFETY RULES**

To avoid personal or environmental damages and to guarantee a proper operation of the equipment, the staff in charge of the installation, set up and maintenance of the equipment must follow the instructions of this manual, specially recommendations and warnings explicitly detailed. In additon, specific instructions for the chemical products to be dosed should be followed.

# 1.- GENERAL DESCRIPTION

The dosing pumps DOSITEC are heavy duty, high precission, electric diaphragm pumps for dosing liquid products.

DOSITEC dosing pumps are manufactured with materials that can resist most chemicals products, even acids. They are designed for all sorts of processes where it is necessary to dose a product into a hydraulic network, such as: food, textile, chemical industry, water treatments, etc. (See materials in Technical Features). In case there is any doubt about compatibility of materials with the products to be used please contact ITC S.L. Technical Service.

The metering pump has been designed to feed liquids with capacities from 0 to 15 l/h and pressures from 0 to 10 bar. They also include a conexion for a level switch..

DOSITEC models:
DOSITEC -MP:   Manual Regulation from 0 to100% by potentiometer
DOSITEC -MD:   Manual Regulation from 0 to100% by keyboard
DOSITEC - Q:     Proportional regulation
DOSITEC - mA:   Analogic regulation by a current signal
DOSITEC - PRC: Control PH or ORP(Redox)
DOSITEC - MF: Multifuntion (Manual flow regulation / proportinonal / Analogical
                    4-20mA / with timer)

# 2.- SHIPMENT

The original packaging is prepared to transport and storage the goods, if it is done in dry, aired spaces and far from sources of heat, always keeping the pump in vertical position.

Inside the pack it is included:

Dosing pump.
Semirigid PE hose, white, lenght 2m.
Flexible PVC hose transparent crystal type, lenght 2m.
Injection valve 3/8" BSP-M
Filter
Manual of instructions

# 3.- TECHNICAL FEATURES

| Flow l/h | Pressure Bar | C/min | Volum ml/cycle | Stroke length mm | Power supply Volts | Power Watts | Weight Kg |
|---|---|---|---|---|---|---|---|
| 2.5 | 10 | 120 | 0.35 | 0.8 | 230V AC | 37 (0.16A) | 3 |
| 2 | 20 | 120 | 0.28 | 1.0 | 230V AC | 58 (0.25A) | 3.8 |
| 6 | 7 | 120 | 0.83 | 1.0 | 230V AC | 37 (0.16A) | 3 |
| 9 | 10 | 120 | 1.25 | 1.4 | 230V AC | 58 (0.25A) | 3.8 |
| 2.5 | 10 | 120 | 0.35 | 0.8 | 12V DC | 24 (2 A) | 3 |
| 6 | 7 | 120 | 0.83 | 1.0 | 12V DC | 24 (2 A) | 3 |

⚠️ Maximum suction high: 2 m
Minimum injection pressure: 0,5 Bar

• IP 65 protection.
• Working temperature: 5-40 ºC
• Standard power supply: 230 V (+/-10%) a.c.50 / 60 Hz single phase.
• Optional power supply: *120 V a.c. 50 / 60 Hz single phase. / 12V d.c.*

## FLOW - PRESSURE



l/h
16
14
12
10
8
6
4
2

9 l/h@10 bar
6 l/h@ 7 bar
2 l/h@ 20 bar
2,5 l/h@ 10 bar

1  2  3  4  5  6  7  8  9  10  11  12  13  14  15  16  17  18  19  20  bar

## LIQUID ENDS MATERIALS:

DIAPHRAGM:        PTFE.
PUMP HEAD:        PVDF
NIPPLES:          PVDF.
VÁLVES BODY:      PVDF
VALVES BALL:      Ceramic
O-RINGS:          FPM ( available in EPDM)
SUCTION HOSE:     PVC flexible.
DISCHARGE HOSE :  Polyethylene.
FILTER:           Polypropylene

**DIMENSIONS**

210

190

172

100

5

130

# 4.- OPERATION

The metering pump is activated by a PTFE diaphragm mounted on a piston of an electromagnet.

When the piston of the electromagnet is attracted, a pressure is produced in the pump body with an expulsion of liquid from the discharge valve.
Once the electric impulse is finished a spring brings the piston back to the initial position, with a recall of liquid through the suction valve.

As the operation is simple the pump does not need lubrication, therefore maintenance is reduced almost to zero.

The materials used for the construction of the pump make it particularly suitable for aggressive products.

# 5.- INSTALLATION

## GENERAL

Install the pump in a dry place and well away from sources of heat and, in any case, at environmental temperatures not exceeding 40°C. The minimum operating temperature depends on the liquid to be pumped,bearing in mind that it must always remain in a liquid state.

## HYDRAULIC CONNECTION

Properly design either in the suction and injection pipe is required, avoiding long lenght and bending pipes as much as possible.



| | | | |
|---|---|---|---|
| ① | SUCTION FILTER | ④ | INJECTION PIPE |
| ② | SUCTION PIPE | ⑤ | COUNTER-PRESSURE VALVE |
| ③ | PRIMING VALVE | ⑥ | INJECTION VALVE |

To prime the pump, first connect the priming hose to the priming valve and drive the other side of the hose to a safety place to pour the air mixed with product.

Open the priming valve and start the pump at maximum flow until having only liquid in the priming outlet.

PRIMING VALVE

PRIMING HOSE

INJECTION HOSE

Select the most appropiate injection point in the pipe to inject the product, and place there a 3/8" part to connect the Injection valve.

3/8"

Install a safety valve in a derivation as near as possible from the pump , in order to protect it and the whole installation from possible over-pressures. This derivation Must derive the liquid to a safe place.

## ELECTRIC CONNECTION

The electric protection of the motor must be installed and adjusted following its nominal intensity (overloaded switch disjuntor).

A disconnection dispositive must be installed in case of emergency.

The equipment must be protected to avoid untimely sudden starts.

230V AC
L1 (BLUE)
L2 (BROWN)
YELLOW /GREEN

| | | MD | Q | mA | PRC | MF |
|---|---|---|---|---|---|---|
| A | | | | | | 1-<br>2-<br>3- Ground<br>4- Reset |
| B | | | 1-<br>2-<br>3- Pulse input (+)<br>4- Pulse input (-) | 1-<br>2-<br>3- Signal mA (+)<br>4- Signal mA (-) | | 1- Signal input mA (+)<br>2- Signal input mA (-)<br>3- Pulse input (+)<br>4- Pulse input (-) |
| C | | 1-<br>2-<br>3- Level switch<br>4- Level switch | 1-<br>2-<br>3- Level switch<br>4- Level switch | 1-<br>2-<br>3- Level switch<br>4- Level switch | 1- Output mA (+)<br>2- Output mA (-)<br>3- Level switch<br>4- Level switch | 1- Flow sensor.<br>2- Flow sensor.<br>3- Level switch<br>4- Level switchl |
| D | | | 1-Output relay.AL3.NO<br>2-<br>3-Output relay (Com)<br>4- | | 1- Alarm relay (NO)<br>2- Alarm relay (NC)<br>3- Alarm relay (Com)<br>4- | 1- Alarm relay (NO)<br>2- Alarm relay (NC)<br>3- Alarm relay (Com)<br>4- |
| E | | | | | Connector BNC<br>pH sensor<br>ORP (redox) sensor | |

## Electrical connection of the dosing pump with electric loads (motors, pumps, electrovalves...)

To avoid damaging the dosing pump (DP) at the disconnection of other pumps or electric motors (M), the following diagrams must be used:

Option 1



Option 2

# 6.- START UP AND REGULATION

**BASE**: Check that the pump is properly secured to the base.

**CHECKING THE HYDRAULIC CIRCUIT**: Check that all valves are open and the liquid from priming valves are derived correctly

**CHECKING OF PUMP**: Visually/hearing check the proper operation of the pump.

**OVER-PRESSURE PROTECTION**: Adjust the safety valve to the correct pressure to protect the installation without exceeding the pump nominal pressure.

**ELECTRIC PROTECTION**: Ajust the electric protection to the pump nominal current.

**SULPHURIC ACID DOSIFICATION**

Replace crystal suction hose with a polyethilene discharge hose. Use PTFE hose for the suction and discharge.

Previously, take away from inside the pump all water present (if water is mixed with sulphuric acid, an overtemperature is caused, damaging the pump.

# DOSITEC MP

MANUAL REGULATION DOSING PUMP

Flow regulated with a potentiometer, it control the impulsion frequency. Adjust of the frequency from 0 to 100%. Special flow regulation at 0-20% frequencies.



1 START
2 STOP
3 Regulation at 20% maximum
4 Regulation at 100% maximum
5 Adjust of the potentiometer in percentage (0-100%)
6 Power LED
7 Injection LED
8 20% regulation LED
9 100% regulation LED


ACCESSORIES

- 1 flexible transparent PVC suction hose 2m
- 1 semirigid white PE injection hose 2m
- 1 injection valve 3/8"
- 1 filter
- 1 user manual
- 1 flexible transparent PVC priming hose.

# DOSITEC MD

DIGITAL DOSING PUMP WITH MANUAL REGULATION

Flow set with keyboard, from 0 - 100%.



1 Increase value
2 Decrease value
3 START /STOP
4 Display
5 Power LED
6 Injection LED

ACCESSORIES

- 1 flexible transparent PVC suction hose 2m
- 1 semirigid white PE injection hose 2m
- 1 injection valve 3/8"
- 1 filter
- 1 user manual
- 1 flexible transparent PVC priming hose.

**LEVEL ALARM**

Pump stops, red LED is on when detects no product for 5 seconds. Level sensor is required.

# DOSITEC mA

ANALOGIC 4-20mA DOSING PUMP

Dosing pump, flow regulated through a 4-20mA external signal.



1  Displays mA or pulse
2  Increase value
3  Decrease value
4  Select function
5  Enter
6  Pulse LED display.
7  Manual selection LED
8  SET POINT 2 / STOP LED
9  SET POINT 1 / STOP LED
10 Meter LED
11 mA LED display
12 Display
13 Injection LED signal
14 Level alarm LED


ACCESSORIES

- 1 flexible transparent PVC suction hose 2m
- 1 semirigid white PE injection hose 2m
- 1 injection valve 3/8"
- 1 filter
- 1 user manual
- 1 flexible transparent PVC priming hose.

## LEVEL ALARM (FAO)
Pump stops, displays FAO, and the alarm LED is on when detecting no product for five seconds. A level sensor is required.


## POWER ON THE PUMP
The pump starts with METER, pulse per minute is displayed.

Use mA / pulse, to display input signal / injections per minute.


## PRIMING
Select MANUAL function and select the frequency to prime the pump.

F to select MANUAL
+/- to change the injection/min ( a 75% of the maximum frequency is recommended)


## PROGRAMMING

## SET POINT 1
Sets the input signal value for the minimum flow, and the frecuency of the injections.

F to select SET1/STOP, show the frecuency of the injections set.

+/- to change the frecuency of the injections (puls/min), for minimum flow (000 for stop)

mA/pulse to select mA.

+/- to change the value of the input signal (mA) for the minimum flow.

Confirm with ENT.

F to select SET POINT 2.

## SET POINT 2

Sets the value of the input signal for the maximum flow, and the frecuency of the injections.

F  to select SET2/STOP, shows the frecuency of the injections.

+/- to change the frecuency of the injections (pulse/min), for maximum flow.

mA/pulse to select mA.

+/- to change the value of the input signal (mA) for the maximum flow.

Confirm with ENT.

## Direct mode
The pump works with an input signal of a higher value than the minimum frecuency (SET1), increasing the frecuency of the injections (flow), proportionally to the increase of the signal, to the maximum frecuency of the injections (SET2).

## Reverse mode
Increasing the value of the input signal means a reduction of the flow. Maximum value of the input signal in mA at SET1, and the minimum value in SET2.

**NOTE:** A  higher frecuency at SET1 than at SET2 is not allowed, so the reverse mode can only be set setting a higher value of the signal (mA) at SET1.

**Example 1:**

**Dositec mA, Flow 10 l/h, Pressure 5 Bar, Signal 4-20 mA**
     4 mA = 0 l/h  = 0%
   12 mA = 5 l/h  = 50%
   20 mA = 10 l/h =100%

**Example 2:**

**Dositec mA, Flow 10 l/h, Pressure 5 Bar, Signal 4-20mA programmed in Reverse mode.**
     4 mA = 10 l/h = 100%
   12 mA =  5 l/h =   50%
   20 mA =  0 l/h =    0%

# DOSITEC Q

PROPORTIONAL DOSING PUMP

Dosing pump with a water counter input. Sets a proportion between the pulses from the water counter and the injections of the dosing pump.
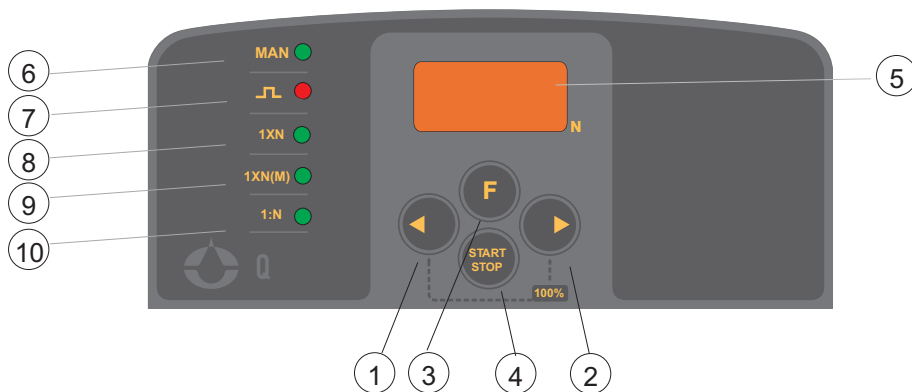
1  Decrease value
2  Increase value
3  Select function
4  START / STOP
5  Display
6  Manual LED
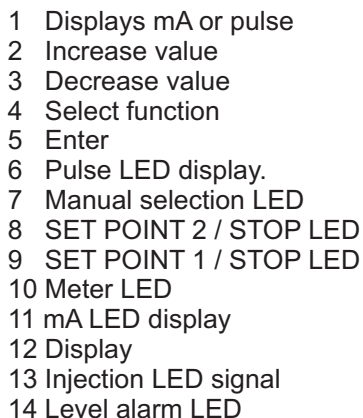7  Injection LED
8  1xN LED  192.168.240.201:5
9  1xN(M) LED
10 1:N LED

ACCESSORIES

- 1 flexible transparent PVC suction hose 2m
- 1 semirigid white PE injection hose 2m
- 1 injection valve 3/8"
- 1 filter
- 1 user manual
- 1 flexible transparent PVC priming hose.

**LEVEL ALARM (AL1)**

Pump stops, displays AL1 and the alarm LED is on when detecting no product for five seconds. A level sensor is required.

**PROGRAMMING**

**MANUAL MODE**

F to select function.

MAN ⚬ | `100`

1) Select injection frequency with ◀ ▶ .
2) Confirm with START/STOP.
3) START/STOP to start.

# PROPORTIONAL MODE

F to select function.

| 1XN MODE | **F** | 1XN(M) MODE | **F** | 1:N MODE |

1XN ⚬ `2` ⟹ 1XN(M) ⚬ `2` ⟹ 1:N ⚬ `2`

1) Set proportion value with ◀ ▶ .
2) Confirm with START/STOP.
3) START/STOP to start

Note: N max. = 999.

**1XN MODE**

For each pulse received by the water counter, injects N times. Frecuency of the injections is set in manual mode.

Example:

- Pump in **1XN** mode.
- Value N=**20**

Water counter gives a pulse to the pump. The pump dosifies 20 injection strokes, while the pump is dosing pulses from water counter are ignored. Once the pump has finished 20 strokes, it waits for another pulse of the water counter to start again.

## 1XN (M) MODE

The same as 1xN mode, but injection frequency is adapted to the time between each pulse received. If the pump receives pulses while it is dosing, injection frecuency is increased if possible.

Example:
Pump receives a pulse and injects "N" times at the maximum frecuency (120pulse/min).
When it receives a second pulse, time between both pulses is used to calculate the injection frecuency so injection strokes are spaced in time, the limit is the maximum frecuency.

## Overpulse Alarm (AL3)

When the pending injection cycles are higher than 4, AL3 is displayed, pump continues dosifying, but the pending cycles are missed.

## 1:N MODE

The pump needs to receive N pulses to inject once. N is set for the user.

Example:

- Pump set mode **1:N**
- Value: **N=20**

After receiving 20 pulses of the watermeter, the pump injects once.

NOTE: 70 pulses/second is the maximum frecuency accepted from the watercounter.

## PRIMING

Pump fast priming, press at the same time ◄ ► .

# DOSITEC PRC

PH, ORP (REDOX) DOSING PUMP

Microcontrolled dosing pump for PH or ORP (redox) control.

1  Decrease value
2  Increase value
3  ESCAPE
4  On/Off
5  ENTER
6  Display
7  Power LED
8  Injection LED
9  Alarm LED


ACCESSORIES

- 1 flexible transparent PVC suction hose 2m
- 1 semirigid white PE injection hose 2m
- 1 injection valve 3/8"
- 1 filter
- 1 user manual
- 1 flexible transparent PVC priming hose.

## DEFAULT PARAMETERS

| | |
|---|---|
| Measure selection | pH |
| Setpoint | 7.2 |
| Hysteresis | 0.1 |
| Control | ácido |
| ON/OFF - Proporcional control | ON/OFF |
| Proportional control start value | Set point+1pH |
| First point calibration procedure | --- |
| Second point calibration procedure | --- |
| Lowest Alarm value | 0.00 |
| Highest Alarm value | 14.00 |
| Over-dosing alarm value | 99:59 (h:m) |
| Menu: BASE / FULL | BASE |
| Password | Disabled |
| Delay powering on | 00:03 (m:s) |
| Delay exit calibration menu | 05:00 (m:s) |
| Calibration 4 mA output | 4 mA |
| Calibration 20 mA output | 20 mA |

## TYPICAL CHARACTERISTICS

| | |
|---|---|
| Room temperature | 0-40ºC |
| Max. Current relay output | 6A (resistive load) |
| | 1A (inductive load) |
| 4-20mA output | 4-20mA (dynamic 0-500Ohm) |
| pH measure | 0-14 (0.01 pH) |
| ORP (mV) measure | -1000 - +1400 (+/-1mV) |

**LEVEL ALARM**

Pump stops, LEVEL and ALARM are displayed, and yellow LED is on when the pump detects no product for 5 seconds. A sensor level is required.

**PROGRAMATION**

Selection of the parameter to control.

First time pump is on, the parameter is flashing (default parameter is pH).

+/- to change parameter.

| | -pH- |
|---|---|
| SETUP | |

Confirm with ENT.

| | -pH- |
|---|---|
| *7.10* | |

Press ENT, use +/- to select the menu:

| MENU |
|---|
| -SETPOINT- |

| MENU |
|---|
| -SETUP- |

| MENU |
|---|
| -CALIB- |

| MENU |
|---|
| -ALARM- |

**SETUP**

| MENU |
|---|
| -SETUP- |

ENT to select

Menu available: BASE(default) / FULL

| MENU | |
|---|---|
| SETUP | *BASE* |

+

| MENU | |
|---|---|
| SETUP | *FULL* |

Press ENT to enter SETUP menu:

+/- to select parameter to control pH, mV
Confirm with ENT.

| | -pH- |
|---|---|
| SETUP | |

Password:

OFF: password disabled

| MENU | |
|---|---|
| SETUP | *OFF* 🔘 |

Use +/- to set a password first digit, press ► to go to the next digit.
Confirm with ENT.

| MENU | |
|---|---|
| SETUP | *0000* 🔘 |

Level or flow sensor. +/- to select LEVEL to connect a level sensor, or ⟱ for a flow sensor.
Confirm with ENT.

| INPUT MODE |
|---|
| |
| LEVEL |

Time to exit the menu after the last button pressed. +/- to change value.
Confirm with ENT.

| MENU | |
|---|---|
| CALIB | *10:00* |
| DELAY | h:m:s |

Delay time to activate the pump. +/- to change value.
Confirm with ENT.

| *00:03* |
|---|
| DELAY STARTUP h:m:s |

To solve problems of inertia of some electrodes, or installations, the delay time switch on of the pump can be set.

**CALIBRATION**

| MENU |
|---|
| CALIB |

press ENT to calibrate

pH calibration:

POINT 1.

Put the sensor in buffer solution pH7.
+/-, to modify value on the display to get 7.00.
Confirm with ENT.

| POINT CALIB 1 | *7.00* pH |
|---|---|

POINT 2
Wash the sensor with water and put it in the second buffer solution (pH 4 or pH9).
+/- to modify value on the display to get the value of the buffer solution.
Confirm with ENT.

| POINT CALIB 2 | *4.00* pH |
|---|---|

ORP (redox) calibration:

POINT 1: Short circuit the BNC connector.
+/-  to select 0.
Confirm with ENT.

Point 2: Connect the sensor and put it in the chemical solution (250, 475, 650 mV).
+/- to select the same value of the chemical solution used.
Confirm with ENT

**SET POINT**

> MENU
> SETPOINT

ENT to set the setpoint.

+/- to set the set point value.
Confirm with ENT

> SET POINT **7.50** pH

Select dosing method. If the pump has to dosify to increase the reading to reach the set point or decrease the reading. To dosify acid, select ▼ , to dosify alkaline product ▲ .
+/- to select. Confirm with ENT.

> SET POINT
>
> DIRECTION ▼

HYSTERESIS (only in FULL menu) , is the diference from the set point where the pump starts or stops.
+/- to change value.
Confirm with ENT.

> HYST
> SET POINT **0.05** pH

Type of control.
ON-OFF: to get the set point, the pump works at a fixed frecuency.
+/- to select. Confirm with ENT.

> MODE
> SET POINT
>
> ON-OFF

PROP: Frecuency of the dosing depends on the reading and the set point distance.
+/- to select. Confirm with ENT.

> MODE
> SET POINT
>
> PROP.

ON-OFF selected, percentage to dose
+/- to change.
Confirm with ENT.

SET POINT **_100_** %
ON-OFF ⊓

ON-OFF selected. SET POINT DELAY. Time
allowed to have the reading away of the set point
before the pump is activated.
+/- to change. Confirm with ENT.

SET POINT **_00.03_**
DELAY m:s

PROP selected. Maximum pH or mV value the
pump will work at the maximum frecuency.
+/- to change. Confirm with ENT.

pH
SET POINT **_8.20_**
PROP. MAX ⊓

Maximum frecuency to dosify.
+/- to change. Confirm with ENT.

pH
SET POINT **_100_** %
PROP. MAX ⊓

Minimum frecuency, when set point value is
got.
+/- to change. Confirm with ENT.

pH
SET POINT **_0_** %
PROP. ⊓ min

Set up of the 4-20mA signal output. Defines the
value of the reading at 4 mA.
+/- to change.
Confirm with ENT.

4 mA pH
SET POINT **_0.00_**

+/- for the value of the reading at 20mA.
Confirm with ENT.

20mA pH
SET POINT **_14.00_**

**ALARMS**

MENU
ALARM

ENT to set alarms.

Maximum value where the alarm is on, and stops
the dosing. When the reading goes to a correct
value the pump is on with the alarm registered on
the screen.
+/- to change.
Confirm with ENT.

pH
ALARM **_14.00_**
MAX

24

Minimum value where the alarm is on, and stops the dosing. When the reading goes to a correct value the pump is on with the alarm registered on the screen.
+/- to change.
Confirm with ENT.

```
ALARM    0.00    pH
                 min
```

OVER DELAY, maximum time to get the set point.
If this time is over OVER DELAY alarm is on, and the dosing is stop.
+/- to change. Confirm with ENT.

```
ALARM         02:00   pH
OVER  DELAY          h:m
```

**RESET** (partial or total)
Switch off and on.

Press ENT

```
MENU
SETPOINT
```

press + and - simultaneously

```
RESET
```

Partial Reset parcial gets default settings, but the calibration parameters are not lost.

Press:  -, -, ▶ .

```
        RESET
PArt
```

Total reset gets all the default settings..

Press: +, +, ▶ .

```
        RESET
tot
```

**STAND-BY** pump is stop

Press + and -  simultaneously untill

```
StbY
```

Press + and - to exit.

# DOSITEC MF

MULTI-FUNCTION DOSING PUMP

Dosing pump allows a manual flow regulation, a proportional dosing refered to a pulse input rate, 4-20mA analogical external signal, o with a timer.



1  Decrease
2  Increase
3  Previous program
4  Next program
5  START /  STOP
6  Display
7  Power LED
8  Injection LED
9  Alarm LED


ACCESORIES

- 1 flexible transparent PVC suction hose of 2m (6.56 feet)
- 1 semi rigid white PE injection hose of 2m (6.56 feet)
- 1 injection valve 3/8"
- 1 filter
- 1 user manual
- 1 flexible transparent PVC priming hose.

## LEVEL ALARM

Pump stops when the pump detects no product for 5 seconds. A sensor level is required.

## PROGRAMMING
First screens

| MENU SELECT ◀ MANUAL ▶ | ▶ | MENU SELECT ◀ 1xN ▶ | ▶ | MENU SELECT ◀ 1xN(M) ▶ | ▶ | MENU SELECT ◀ 1:N ▶ | ▶ |
| MENU SELECT ◀ mA ▶ | ▶ | MENU SELECT ◀ PPM ▶ | ▶ | MENU SELECT ◀ ALARM ▶ | ▶ | MENU SELECT ◀ REMOTE ▶ | ▶ |
| MENU SELECT ◀ BUZZER ▶ | ▶ | MENU SELECT ◀ CLOCK ▶ | ▶ | MENU SELECT ◀ TIMER ▶ | ▶ | MENU SELECT ◀ LENGUAGE ▶ | |

Dosing control modes. MANUAL / 1xN / 1xN(M) / 1:N / mA / PPM:

## MANUAL MODE
Pump runs a constant dosing. Frecuency of the injections can be set upon three different scales.

| MENU SELECT ◀ MANUAL ▶ | ▼ | MENU SELECT ◀ PULSE / MIN. ▶ | ▼ | PULSE / MINUTE ◀ 120 ▶ | ◀ ▶ to select pulse/minute |

▶

| | MENU SELECT ◀ PULSE / HR. ▶ | ▶ | PULSE / HOUR ◀ 120 ▶ | ◀ ▶ to select pulse/hour |

▶

| | MENU SELECT ◀ PULSE / DAY ▶ | ▶ | PULSE / DAY ◀ 48 ▶ | ◀ ▶ to select pulse/day |

Confirm with START/STOP.
Pump starts at the selected frecuency.

MAN.    120P/M
              00:00

## PROPORTIONAL MODE
Proportional dosing between the pulses of the water counter, and the pump injections.

## 1XN MODE
For each pulse received, the pump injects "N" times. N is set by the user, frecuency is set in manual mode.

| MENU SELECT ◀ 1xN ▶ | ⬤▼ | MENU 1xN ◀ 10 ▶ | ◀ ▶ to set "N" injections. Confirm with START/STOP | 1x N    n= 10    12:00 |
|---|---|---|---|---|

Example:
- Pump set on **1XN** mode.
- N= **20**
- When the pump receives a pulse, it starts dosing 20 injections. If the pump receives another pulse while it is dosing, the pulse is ignored. When the pump finishes the 20 injections, it can accept another pulse.

## 1XN (M) MODE
Works as 1xN mode, but frecuency of the pump is adjusted to time between pulses received. If the pump received a pulse while it is dosing, it is memorized and adjusts the frecuency again.

| MENU SELECT ◀ 1xN(M) ▶ | ⬤▼ | MENU1xN(M) ◀ 10 ▶ | ◀ ▶ to set "N" injections . Confirm with START /STOP. | 1xN(M)    n=10    12:00 |
|---|---|---|---|---|

## Overpulse alarm (AL3)
When the number of pulses remaining to inject is higher than 4xN, AL3 is activated. The pump continues working, but the pending injections are not done.

Example:
Pump receives a pulse, dose "N" injections at the maximum frecuency (120 injection/minute).
At the second pulse received, the pump adjust the injection frecuency to the time between first and second pulse. Maximum límit is maximum frecuency.

## 1:N MODE
For each N pulses received the pump injects once. N is set for the user.

| MENU SELECT<br>◀  1:N  ▶ | ⬤▼ | MENU 1:N<br>◀  10  ▶ | ◀ ▶ to select the number of pulses.<br>Confirm with START /STOP. | 1: N   n= 10<br>12:00 |
|---|---|---|---|---|

Example:
- Pump set on **1:N** mode.
- N= **20**
- When the pump receives 20 pulses, injects once.

## mA MODE  (4-20mA)
Frecuency of the injection is adjusted by an external 4-20mA signal. Minimum and maximum injection frecuency can be set.

| MENU SELECT<br>◀  mA  ▶ | ⬤▼ | SET mA (1)<br>◀  4.0  ▶ | ◀ ▶ to select minimum mA of the signal.<br>Confirm with ▾ . |
|---|---|---|---|

| SET mA (2)<br>◀  20.0  ▶ | ◀ ▶ to select maximum mA of the signal.<br>Confirm with ▾ . |
|---|---|

| PULSE / MIN (1)<br>◀  0  ▶ | ◀ ▶ to select flow(injections/ minute) of the signal SET mA (1).<br>Confirm with ▾ . |
|---|---|

| PULSE / MIN (2)<br>◀  120  ▶ | ◀ ▶ to select flow (injections/ minute) of the signal SET mA(2).<br>Confirm with ▾ . |
|---|---|

| BELOW mA (1)<br>◀  STOP  ▶ | BELOW mA (1)<br>◀ CONTINUE ▶ | ◀ ▶ to select STOP or CONTINUE  the dosing when signal value is below SET mA (1).<br>Confirm with ▾ . |
|---|---|---|

| OVER mA (2) | OVER mA (2) |
|:---:|:---:|
| ◀ STOP ▶ | ◀ CONTINUE ▶ |

◀ ▶ to select STOP or CONTINUE the dosing when signal value is over SET mA (2).
Confirm with ▾ .

Pres START/STOP to start running according the configuration set.

| mA | :00.0 |
|---|---:|
| | 12:00 |

## PPM MODE
Doses in Parts Per Million.

| MENU SELECT | | L/P W.METER |
|:---:|:---:|:---:|
| ◀ PPM ▶ | ▼ | ◀ 0.10 ▶ |

◀ ▶ to select liters/pulse of the flowmeter.
Confirm with ▾ .

| cc/ INJECTION |
|:---:|
| ◀ 0,01 ▶ |

◀ ▶ to select the injection volume/cycle (ml/cycle) (page 5).
Confirm with ▾ .

| SOLUTION % |
|:---:|
| ◀ 100 ▶ |

◀ ▶ to select the concentration value (%) of the product to inject.
Confirm with ▾ .

| SET PPM |
|:---:|
| ◀ 1.0 ▶ |

◀ ▶ to select the set point in p.p.m (Parts Per Milion), between 0,01-2000 ppm.
Confirm with ▾ .

START/STOP, to start running according the configuration set.

| PPM | = 1.0 |
|---|---:|
| | 12:00 |

## ALARM
Pump stops, yellow led is on, and the buzzer is activated when the pump detects no injects product programmed (some parameters must be set). A flow sensor is required.

| MENU SELECT | | REF. PULSES |
|:---:|:---:|:---:|
| ◀ ALARM ▶ | ▼ | ◀ 0 ▶ |

◀ ▶ number of reference pulses.
Confirm with ▾ .

| MAX DIFF. |
|:---:|
| ◀ 0 ▶ |

◀ ▶ select maximum distance of the ref pulses accepted.
Confirm with ▾ .

30

## REMOTE ACTIVATION

The pump can be activated with a contact at a maximum distance of 100 meters.
(3-4 Connector C, page 9).
Open contact activation(NORMAL), close contact activation(REVERSED).

| MENU SELECT | | MENU REMOTE | NORMAL |
| REMOTE | ▼ | NORMAL | Open contact: pump on |

NORMAL
Open contact: pump on
Close contact: pump off
◀ ▶ to select.
Confirm with ▼.

MENU REMOTE
◀ REVERSED ▶

REVERSED
Open contact: pump off
Close contact: pump on
◀ ▶ to select.
Confirm with ▼.

## BUZZER

Buzzer shows if the pump alarm is on.

MENU SELECT
◀ BUZZER ▶

MENU BUZZER
◀ ENABLED ▶

ENABLED
◀ ▶ to select.
Confirm with ▼.

MENU BUZZER
◀ DISABLED ▶

DISABLED
◀ ▶ to select.
Confirm with ▼.

## CLOCK

MENU SELECT
◀ CLOCK ▶

CLOCK SET
◀ "12:00" - MON ▶

◀ ▶ select time.
Confirm with ▼.

CLOCK SET
◀ 12:00 - "MON" ▶

◀ ▶ select day.
Confirm with ▼.

CLOCK SET
◀ "2007" JAN 01 ▶

◀ ▶ select year
Confirm with ▼.

```
┌──────────────┐   ◀ ▶ select the month.
│  CLOCK SET   │   Confirm with ▼ .
│◀2007 "JAN" 01▶│
└──────────────┘

┌──────────────┐   ◀ ▶ select the day.
│  CLOCK SET   │   Confirm with ▼ .
│◀2007 JAN "01"▶│
└──────────────┘
```

## TIMER

Timer in a day can activate 8 cycles start-stop of the pump.

```
┌──────────────┐       ┌──────────────┐   TIMER OFF
│ MENU SELECT  │   ⬤   │  MENU TIMER  │   ◀ ▶ select the function.
│◀    TIMER   ▶│   ▼   │◀ TIMER OFF  ▶│   Confirm with ▼ .
└──────────────┘       └──────────────┘
```

```
┌──────────────┐   DAILY SETS  number of cycles start-stop in a
│  MENU TIMER  │   day (max 8).
│◀ DAILY SETS ▶│   ◀ ▶ select function.
└──────────────┘   Confirm with ▼ .
```

```
┌──────────────┐   SET1 ON start time.
│        SET1  │   ◀ ▶ select time hour:minute.
│ ON ◀ 1:00 ▶  │   Confirm with ▼ .
└──────────────┘
```

```
┌──────────────┐   SET1 OFF stop time.
│        SET1  │   ◀ ▶ select time, hour: minute.
│ OFF ◀ 1:20 ▶ │   Confirm with ▼ .
└──────────────┘
```

Repeate depending the number of cycles (max. 8) required
per day.

```
┌──────────────┐   WEEK SETS  maximum of 8 start-stop cycles
│  MENU TIMER  │   in a week.
│◀ WEEK SETS ▶ │   ◀ ▶ select function.
└──────────────┘   Confirm with ▼ .
```

```
┌──────────────┐   SUNDAY SET 1  ON .
│ SUNDAY SET1  │   ◀ ▶ select time.
│ ON ◀ 1:00 ▶  │   Confirm with ▼ .
└──────────────┘
```

```
SUNDAY  SET1
OFF ◀ 1:20 ▶
```
SUNDAY SET 1 OFF  Sunday stop time.
◀ ▶ to select time.
Confirm with ▾ .

Repeate for cycles number of each day of the week.
Maximum 8 for each day.

**LANGUAGE**

Select language.

```
MENU SELECT
◀ LANGUAGE ▶
```
🔘
```
SET LANGUAGE
◀ ENGLISH ▶
```
English.
◀ ▶ select language.
Confirm with ▾ .

```
MENU LINGUA
◀ ITALIANO ▶
```
Italian.
◀ ▶ select language.
Confirm with ▾ .

# 7.- MAINTENANCE

*Before any maintenance operation  check:*

*The pump is stopped and disconnected from the electric supply.*

*There is no pressure  neither inside the head nor in the impulsion pipe. It is advisable to empty the head before opening it.*

*The staff in charge of the maintenance will use the adequate protection means in order to manipulate the dosed liquid.*

Periodically check the chemical tank level to avoid the pump operates without liquid. This would not damage the pump, but may damage the process plant due to lack of chemical.
DOSITEC series dosing pumps are all supplied with level control setting. The level switch is not included therefore to be ordered separately.
Level control stops pump operation once the level into the chemical is lower then the level switch,activating a L.E.D. on the pump .

Check the pump operating condition at least every 6 months, pump head position,screws, bolts and seals; check more frequently when aggressive chemicals are used.

Is recomended to clean periodically the hydraulic part(valves and filter). Cleaning frecuency will depend on the aplication.

## TROUBLE SHOOTING

### MECHANICAL FAULTS

As the system is quite robust there are no apparent mechanical problems. Occasionally there might be a loss of liquid from the nipple because the tube nut has loosened, or more simply the discharge tubing-has broken.

Very rarely there may be losses caused by the breakage of the membrane, or by the membrane seals in which case they have to be replaced by disassembling the four screws of the pump head, when re-mounting the pump head ensure that the screws are replaced properly, along with "O" ring.

After repair, the metering pump will need to be cleaned of additive residues which can damage the pump case.

| PROBLEM | CAUSE | SOLUTIÓN |
|---|---|---|
| The pump gives pulses but doesn't inject | Valves not clean | Remove the suction and injection valves, clean them , and assemble them in the same position. |
| | Damaged valves | When the parts are swallen, check valve material against a chemical compatibility chart and fit the correct material. |
| | Filter not clean | Clean the filter |
| The pump doesn't give any pulse and LED are off | Power supply failure | Chech the power supply. If it still doesn't work contact with the Technical Service |
| The pump doesn't give any pulse and green LED is on and red LED is off | START failure | Press  START/STOP. If it still doesn't work contact with the Technical Service. |
| Pump pulses are not constant | Power supply failure | Check the input voltageis within +/- 10% rated voltage |
| The pump gives only one pulse | | Disconnect the pump and contact immediately to the Technical Service |

# DOSITEC PARTS

59212

59203  59206
59204  59207
59205  59208

59609  59612  59615  Fuses:
59610  59613  59616      59315
59611  59614  59617      59316

59201

59213

59602  59605  59608
59603  59606
59604  59607

59210

59158  59161
59159  59162
59160

59300

59200
59215

59154
59631

59211

59308

59155

59310

59209

59309

**59-050-F**

59807-F

59-863-F

59801-F

59809-F

59849

59810-F

59805-F

59848

59303
59306

59157

59303

59800-F

59307

59302

59305

59156-F

59-862-F

36

## BALL VALVE  4x6 PVDF / FPM

### Discharge  59-863-F

- ① ← 59829
- ② ← 59830
- ③ ← 59831
- ④
- ⑤
- ⑥
- ⑦
- ⑧
- ⑨ ← 59317 (FPM)
- ⑩     59318 (TFE P)
- ⑦
- ⑧
- ⑨
- ⑪
- ⑩
- ⑫
- ⑬

### Suction  59-862-F

- ⑬
- ⑫
- ⑩
- ⑪
- ⑦
- ⑧
- ⑨
- ⑩
- ⑦
- ⑧
- ⑨
- ⑥
- ⑤
- ④
- ③
- ②
- ①

## CHECK VALVE 4X6

### 59-806

- 59811
- 59812
- 59802

## FOOT FILTER 4X6

### 59-851-P

- 59824
- 59813
- 59817

# LIST OF PARTS

| CODE | DESCRIPTION | UNITS |
|------|-------------|-------|
| 59154 | Connector female 4 pins Dositec | 2 |
| 59155 | Conector g4a5m Dositec | 2 |
| 59156-F | Cylinder diaphragm Dositec PVDF | 1 |
| 59157 | Cylinder cap | 4 |
| 59158 | Diaphragm backseat Dositec 2.5 | 1 |
| 59159 | Diaphragm backseat Dositec 6 | 1 |
| 59160 | Diaphragm backseat Dositec 9 | 1 |
| 59161 | Diaphragm backseat Dositec 2-20 | 1 |
| 59162 | Diaphragm backseat support Dositec 2-20 | 1 |
| 59200 | Diaphragm PTFE Dositec | 1 |
| 59201 | Lower lexan Dositec | 1 |
| 59203 | Lexan MP | 1 |
| 59204 | Lexan MD | 1 |
| 59205 | Lexan Q | 1 |
| 59206 | Lexan mA | 1 |
| 59207 | Lexan MF | 1 |
| 59208 | Lexan PRC | 1 |
| 59209 | Cylinder cover | 1 |
| 59210 | Hydraulic case | 1 |
| 59211 | Electronic case Dositec | 1 |
| 59212 | Flow adjustment knob | 1 |
| 59213 | O-ring case | 1 |
| 59215 | Diaphragm PTFE Dositec 2-20 | 1 |
| 59300 | Screw M4x8 A2 | 4 |
| 59302 | Washer D4 6593 Dositec | 4 |
| 59303 | O-ring 4,76 x 1,78 FPM priming valve | 2 |
| 59305 | Screw M4x35 Din 912 | 4 |
| 59306 | O-ring 3,17x1,78 FPM priming valve | 1 |
| 59307 | O-ring 48.89x2.62 FPM | 1 |
| 59308 | Screw 2,9x9,5 | 4 |
| 59309 | Screw 4x16 | 6 |
| 59310 | Screw 2,9x13 | 2 |
| 59315 | Fuse 1A Dositec Q/PRC | 1 |
| 59316 | Fuse 1A 20x5 Dositec MP/MD/mA/MF | 1 |
| 59317 | O-ring 3,69x1,78 FPM | 4 |
| 59318 | O-ring 3,69x1,78 TFE/P | 4 |
| 59602 | Electromagnet D80 2/12V | 1 |
| 59603 | Electromagnet D80 6-7 12V | 1 |
| 59604 | Electromagnet D90 9-5 12V | 1 |
| 59605 | Electromagnet D80 2-10 | 1 |
| 59606 | Electromagnet D80 6-7 | 1 |
| 59607 | Electromagnet D90 9-10 | 1 |
| 59608 | Electromagnet 2-20 | 1 |
| 59609 | Electronic card Dositec MP 12Vdc | 1 |
| 59610 | Electronic card Dositec MP | 1 |
| 59611 | Electronic card Dositec MD | 1 |
| 59612 | Electronic card Dositec Q | 1 |
| 59613 | Electronic card Dositec mA | 1 |
| 59614 | Electronic card Dositec MF | 1 |
| 59615 | Electronic card Dositec PRC | 1 |
| 59616 | Electronic card (power)12Vdc Dositec MF | 1 |
| 59617 | Electronic card (power) 230Vac Dositec MF | 1 |
| 59631 | Connector female 4 pins Dositec ALM | 1 |
| 59800-F | Drain connector Dositec PVDF | 1 |
| 59801-F | Spacer of injection valve PVDF | 1 |
| 59802 | Nut for 3/8"" lip valve connector | 1 |
| 59805-F | Lip valve guide 3/8 PVDF | 1 |

| CODE | DESCRIPTION | UNITS |
|------|-------------|-------|
| 59807-F | Drain knob PVDF | 1 |
| 59809-F | Screw for priming Dositec PVDF | 1 |
| 59810-F | Drain rod Dositec PVDF | 1 |
| 59811 | Cylinder for injections valve | 1 |
| 59812 | Body of injections valve | 1 |
| 59813 | PP fiber  foot filter 4x6-3/8 | 1 |
| 59814 | Lip valve for foot filter | 1 |
| 59817 | Foot filter body | 1 |
| 59824 | Connector for foot valve 4x6 with filter | 1 |
| 59829 | Nut for 3/8' valve connector PVDF | 1 |
| 59830 | Valve flange  pipe 4x6 PVDF | 1 |
| 59831 | Valve connector pipe 4x6 PVDF | 1 |
| 59848 | O-ring 11,1x1,78 FPM | 1 |
| 59849 | Ball 4.7 Dositec | 1 |

**ASSEMBLIES**

| CODE | DESCRIPTION | UNITS |
|------|-------------|-------|
| 59-050-F | Cylinder Dositec assembly PVDF FKM | 1 |
| 59-806 | Injection check valve 4x6 3/8 | 1 |
| 59-851-P | Foot check valve 4x6 with PP fiber filter | 1 |
| 59-862-F | Suction check valve ball 4x6 PVDF/FPM | 1 |
| 59-863-F | Discharge check valve ball 4x6 PVDF/FPM | 1 |

**OPTIONS & ACCESORIES**

| CODE | DESCRIPTION |
|------|-------------|
| 18311 | Floating level switch |
| 18385 | Hose 4x6 PTFE  Dositec |
| 59-049-F | Kit accessories Dositec PVDF |
| 59-050-E | Cylinder Dositec assembly PVDF EPDM |
| 59-080-F | Cylinder with automatic degassing valve assembly PVDF |
| 59101 | Plate for level sensor stand |
| 59-806-E | Injection check valve 4x6 3/8 EPDM |
| 59-806-F | Injection check valve ball 4x6 ½ PVDF |
| 59-851-F | Foot check valve 4x6 with PVDF filter |

## Kit accessories Dositec PVDF



**59-049-F**

59-851-F          59-806-F

18385

## EC CONFORMITY DECLARATION

C E

*I.T.C S.L..*
*Mar Adriàtic, 1*
*Polígono Torre del Rector*
*08130 Santa Perpètua de Mogoda*

*Declares that all models DOSITEC products, identified by a serial number and year of manufacture, strictly fulfill low voltages directives 73/23/CE and electromagnetic compatibility directives 89/336/CE, as long as installation, use and maintenance are carried out following the prevailing regulation and following the instructions contained in the handbook.*

*Antón Planas*
*Manager*

---

## WARRANTY

*I.T.C. S.L. warrants the product specified in this document for a period of 2 years fromt he purchase date except for the wearing parts such as valves, seals, nipples, hoses and filter. This warranty obligation is limited to the free replacement of the damaged parts due to any material or manufacture defect. This warranty does not include periodic maintenance and damage resulting from misuse.*

*The equipment must be sent to I.T.C. S.L. Service Center with prepaid transport charges, and will be sent back with transport charges for customer's account.*

*The warranty document with sales date and shop stamp or an invoice copy must be sent with the equipment.*

MODEL
_____

SERIAL #
_____

Date of sale and shop stamp

DATE:

_____